


BROIL ELEMENTS
 #1,2,7,8 CONTROLLED
 3,4,5,6 - UNCONTROLLED
 9,10,11,12

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32 VDC INPUT

ALL WIRES #18 AWG THIN UNLESS NOTED

ELEMENT #1N 4081, 240V, 2200 W — 208V Y 120V, 3R, 50/60 HZ, 64A
 * #1N 4015, 250V, 2200 W — 230V Y 120V, 3R, 50/60 HZ, 66A

A NEW PLATEN THERMOSTAT, DELETE C/B JUMPER, INCREASE WIRE SIZE. WAS #1 N 4011-P240C (2) 6GA. 11-7-95 02

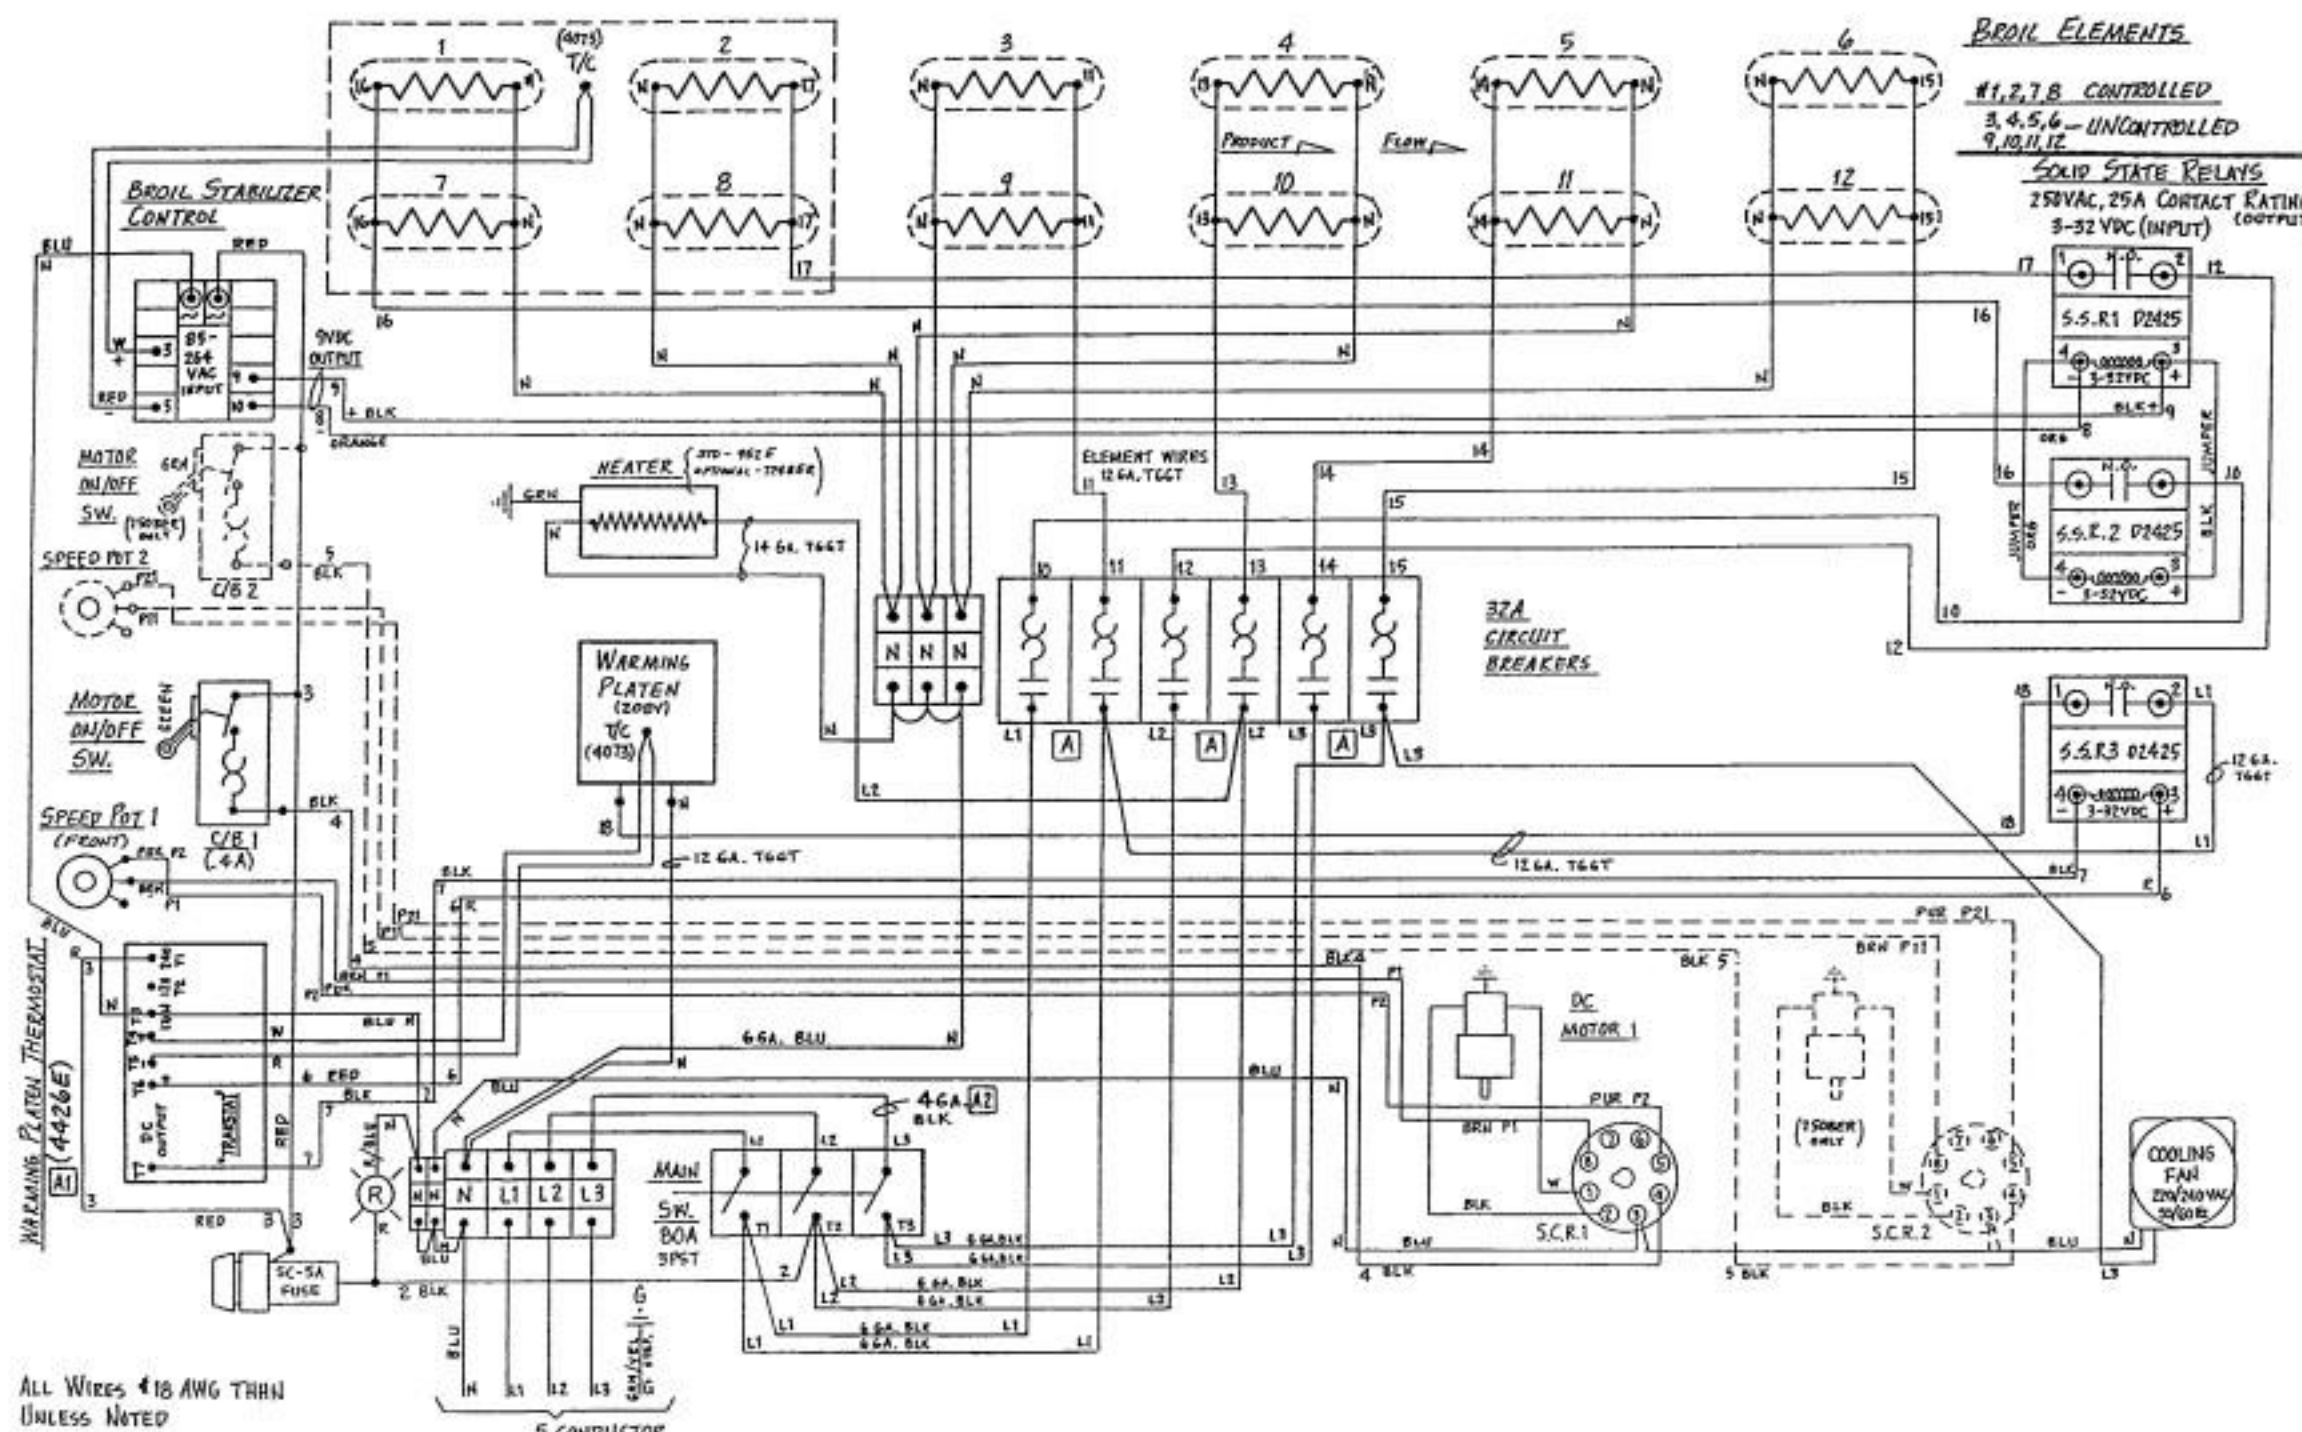


BROIL ELEMENTS
 #1,2,7,8 CONTROLLED
 3,4,5,6 - UNCONTROLLED
 9,10,11,12
SOLID STATE RELAYS
 250VAC, 25A CONTACT RATING
 3-32 VDC (INPUT) (OUTPUT)

ALL WIRES #18 AWG THHN UNLESS NOTED

5 CONDUCTOR
 ELEMENTS { #4075, 250V, 2200 W → (380V) Y 220V, 3 φ, 50/60 HZ, 39 A
 { #4076, 265V, 2100 W → (415 V) Y 240V, 3 φ, 50/60 HZ, 39 A

A NEW PLATEN THERMOSTAT, DELETE C/B JUMPERS, INCREASE WIRE SIZE. WAGO (1) PH 4071-PMAC (2) 6 GA. 11-7-95 DZ

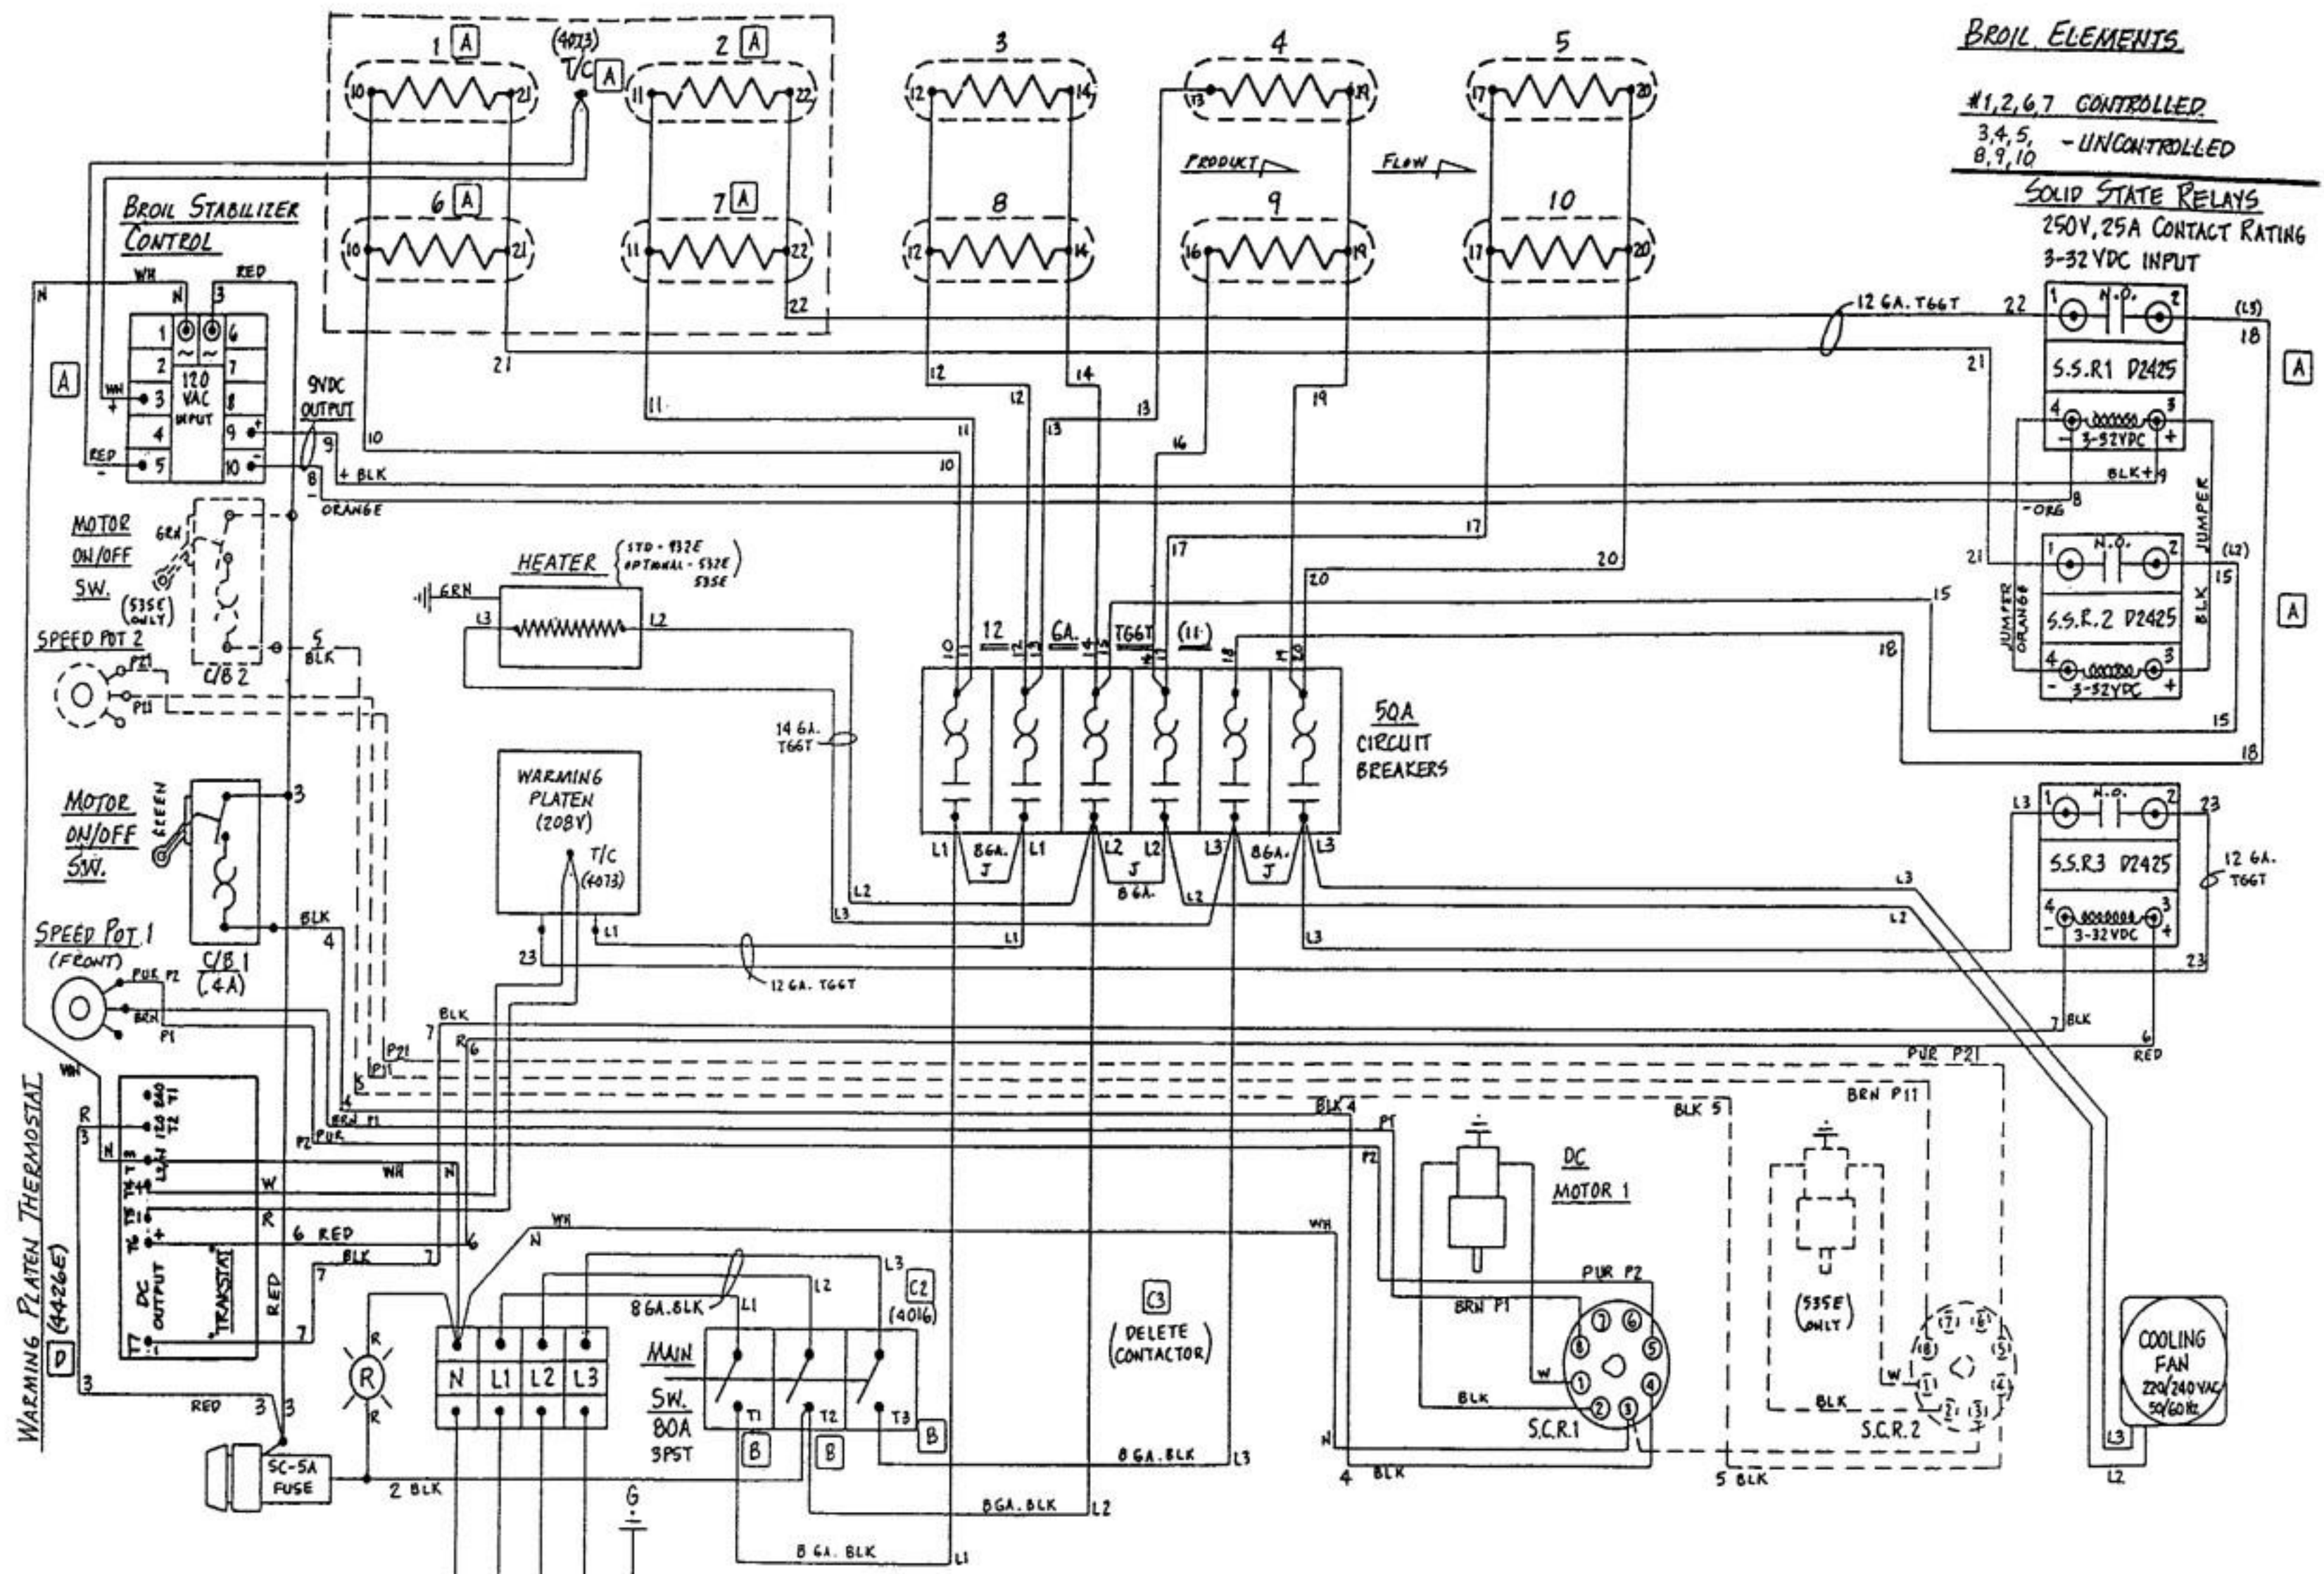

BROIL ELEMENTS

#1,2,6,7 CONTROLLED
 3,4,5, 8,9,10 - UNCONTROLLED


SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32VDC INPUT

17

ALL WIRES #18 AWG THHN
 UNLESS NOTED

ELEMENT P/N 4081, 240V, 2200 W → 208V Y120V, 3 R, 50/60HZ, 55A
 • P/N 4075, 250V, 2200 W → 230V Y120V, 3 R, 50/60 HZ, 56A

D	NEW PLATEN THERMOSTAT. WAS P/N 4071-P240C	11-7-95	DZ
C	CHANGE PLATEN ATC, MAIN SW., DELETE CONTACTOR, ADD 2ND SCR. WAS: 1 44039C 2 4059 3 4067	5-10-95	DZ
B	RE-LABEL CONTACTOR FOR U.I.	9-16-94	DZ
A	RE-DMN. WAS: (4) ELEMENTS, (1) ATC, (1) SSR, (1) T/C	7-14-93	DZ

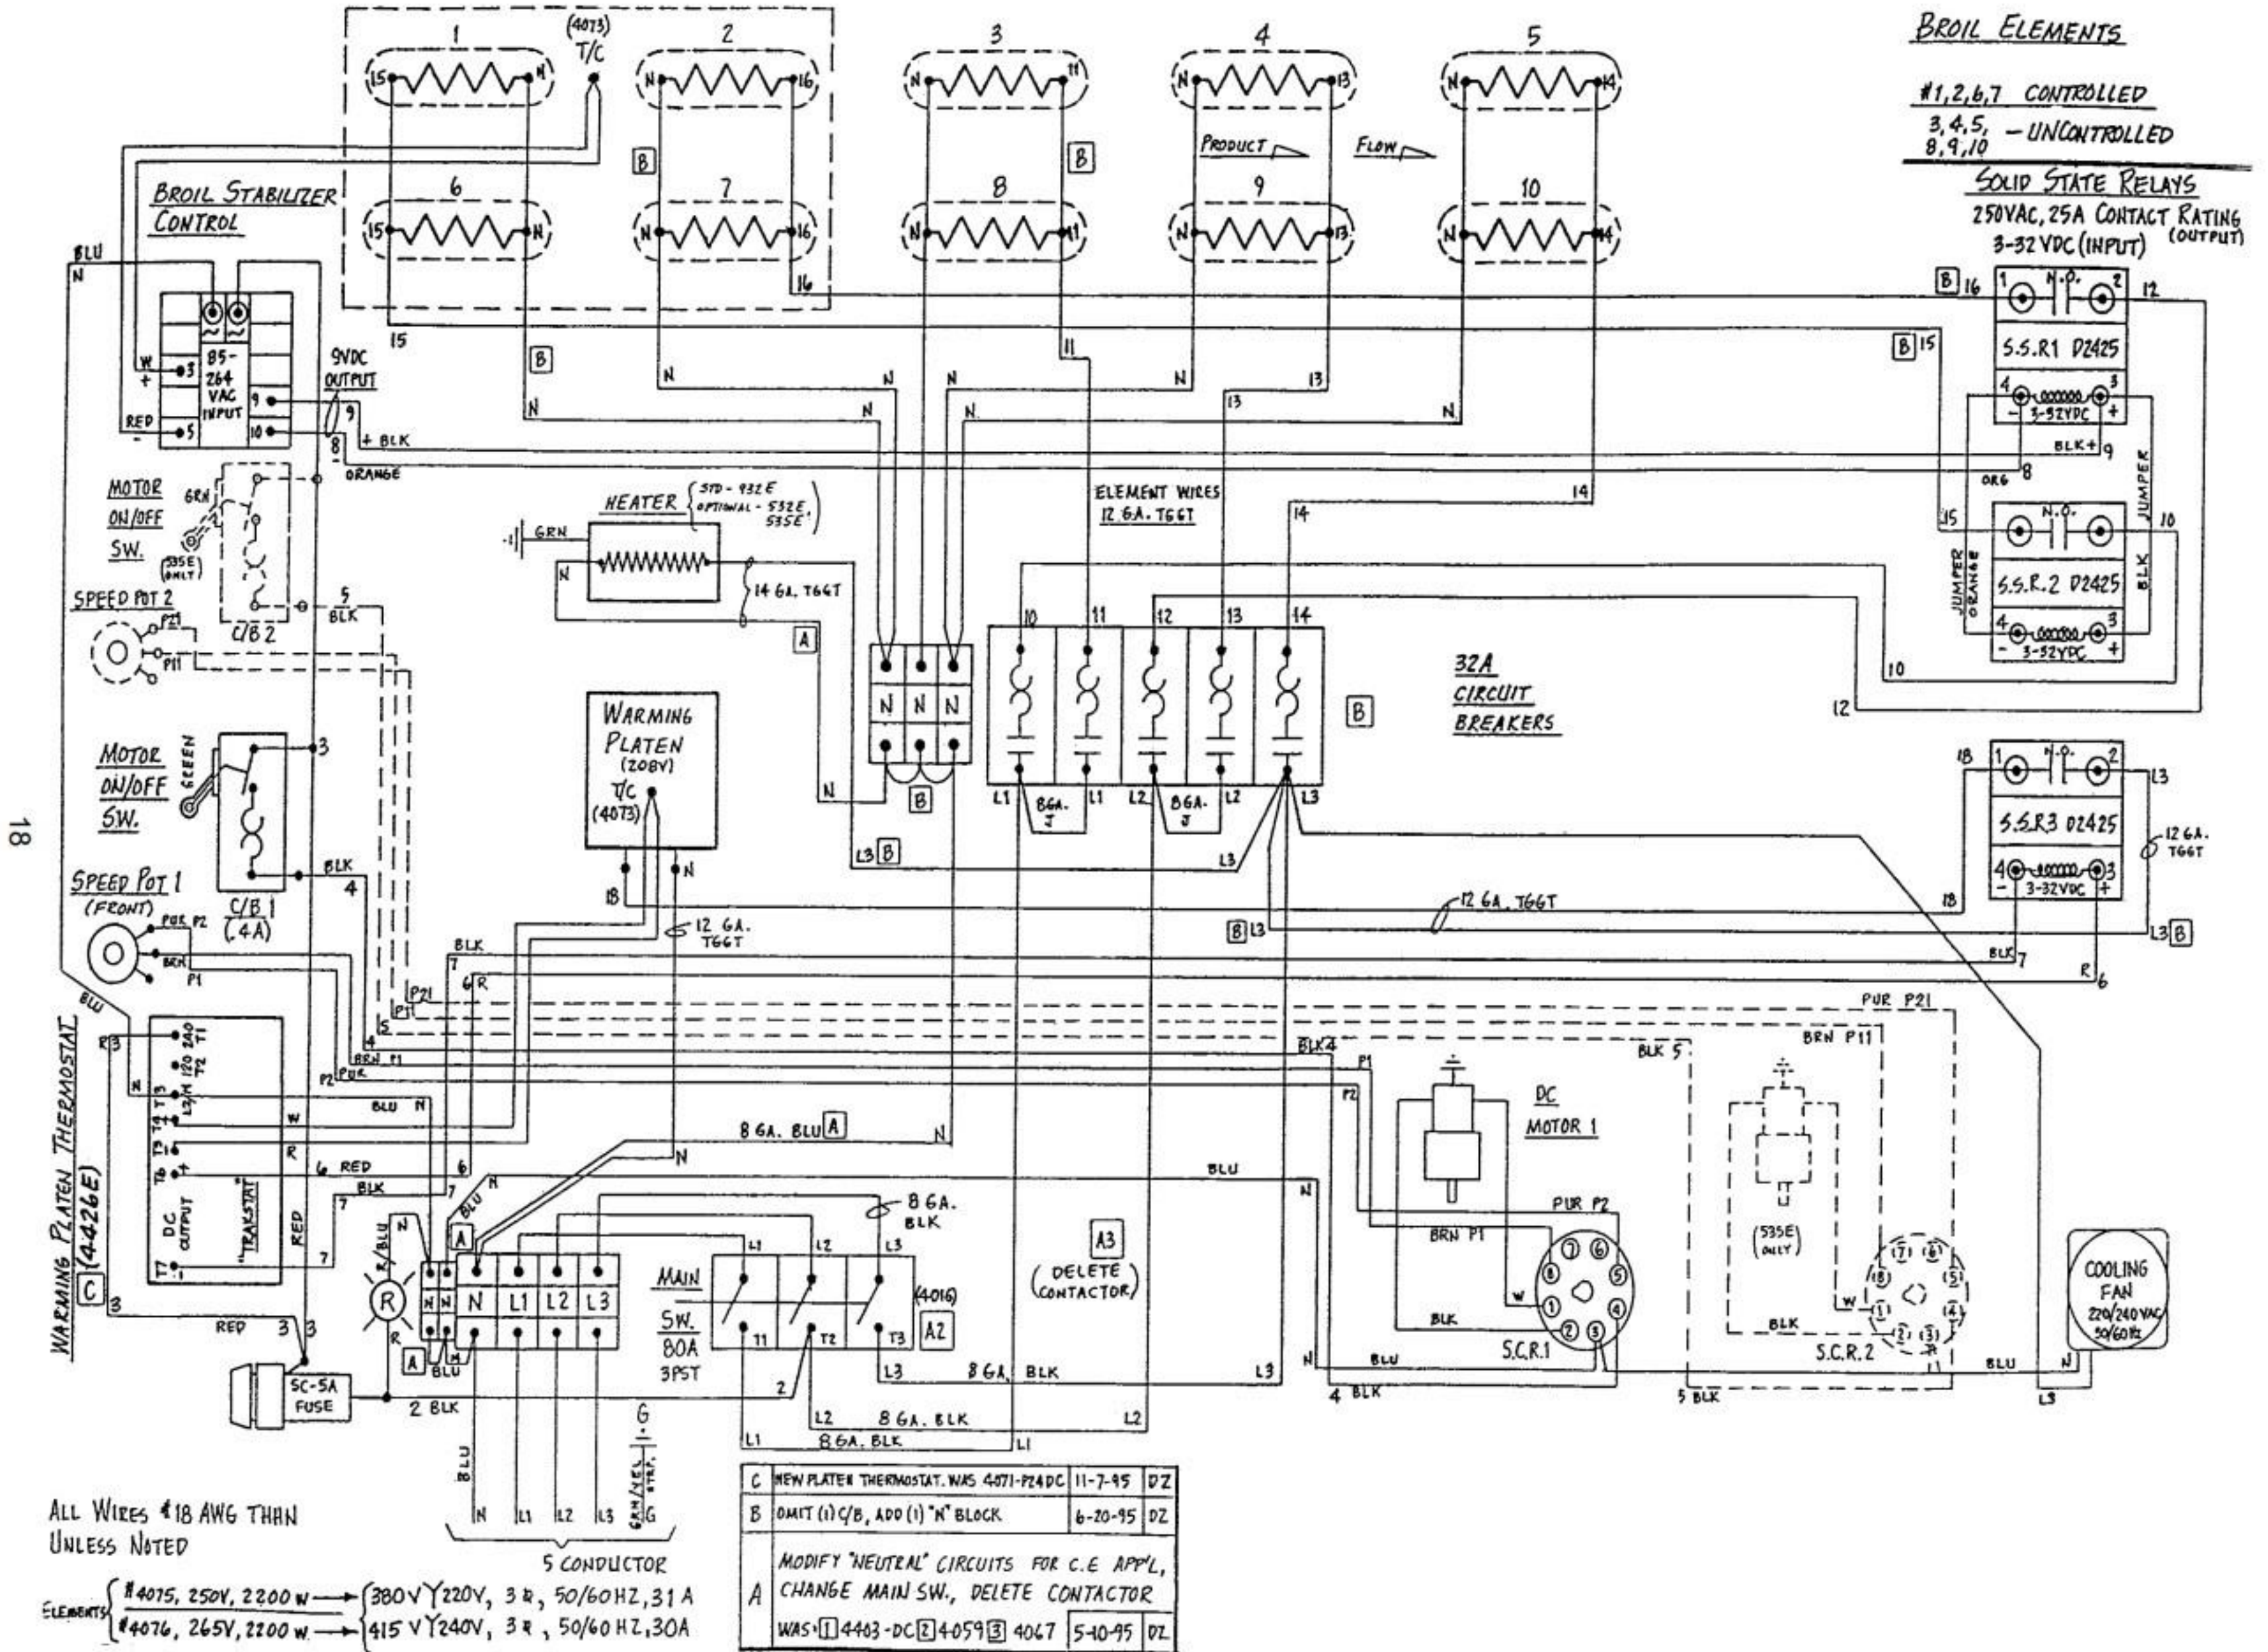

BROIL ELEMENTS

#1,2,6,7 CONTROLLED
 3,4,5, - UNCONTROLLED
 8,9,10

SOLID STATE RELAYS
 250VAC, 25A CONTACT RATING
 3-32VDC (INPUT) (OUTPUT)

18

ALL WIRES #18 AWG THIN
 UNLESS NOTED

ELEMENTS

#4075, 250V, 2200 W	→	380V Y 220V, 3 φ, 50/60 HZ, 31 A
#4076, 265V, 2200 W	→	415 V Y 240V, 3 φ, 50/60 HZ, 30A

C	NEW PLATEN THERMOSTAT WAS 4071-P24DC	11-7-95	DZ
B	OMIT (1) C/B, ADD (1) "N" BLOCK	6-20-95	DZ
MODIFY "NEUTRAL" CIRCUITS FOR C.E APP'L, CHANGE MAIN SW., DELETE CONTACTOR			
	WAS: [1] 4403-DC [2] 4059 [3] 4067	5-10-95	DZ