


BROIL ELEMENTS

1, 2, 3, 8 CONTROLLED
 4, 5, 6 - UNCONTROLLED
 9, 10, 11, 12


SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32VDC INPUT

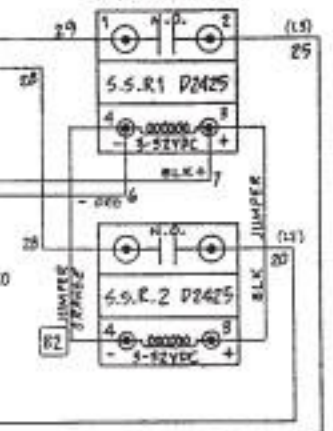

ALL WIRES #18 AWG THIN UNLESS NOTED

ELEMENTS
 *4081, 240V, 2200W → 208V Y 120V, 3 #, 50/60 HZ, 69A
 *4075, 250V, 2200W → 230V Y 120V, 3 #, 50/60 HZ, 71A

C	NEW PLATEN THERMOSTAT, DELETE C/B JUMPS, INCREASE WIRE SIZE, WIRE 1 (PWR) 4071-P 2 6 GA. 10-7-95 DZ
B	DELETE RECEPT, PWR. WIRE TO C/B; ADD D JUMPS; THIN WIRE COND. WPS: 1 DUAL WIRE 2 BLK 5-31-95 DZ
A	REVISE TERMINAL STRIP ADD L W BLK 5-10-95 DZ

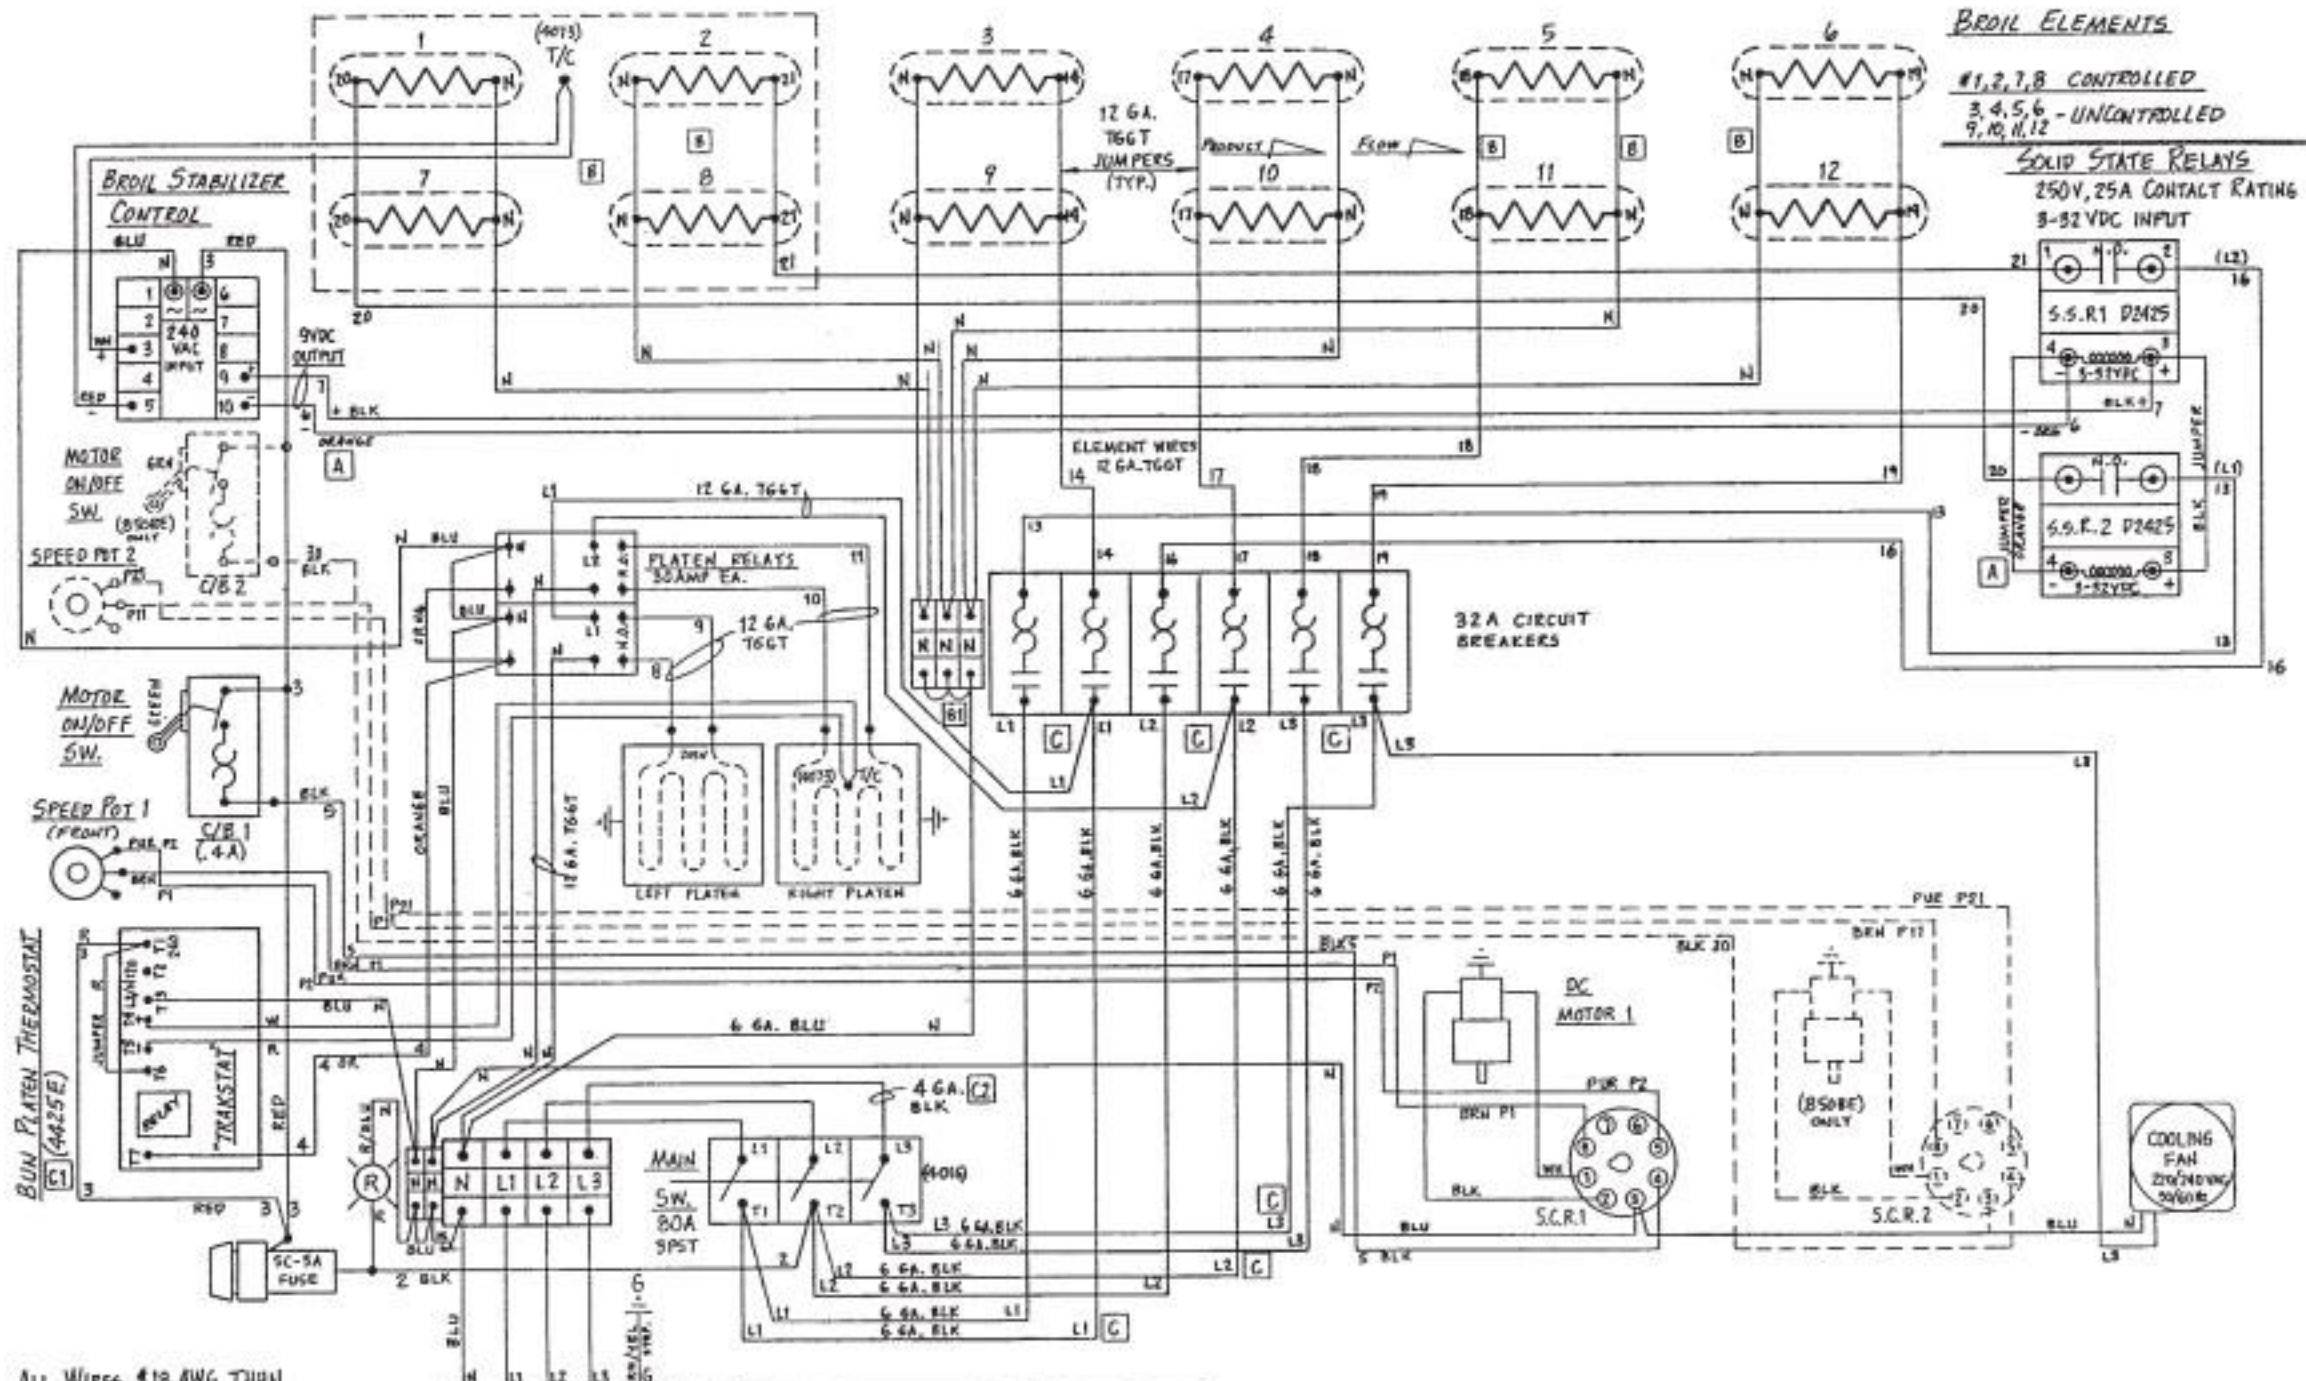

BROIL ELEMENTS
 #1, 2, 7, 8 CONTROLLED
 3, 4, 5, 6 - UNCONTROLLED
 9, 10, 11, 12


SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32VDC INPUT

ALL WIRES #18 AWG THIN
 UNLESS NOTED

ELEMENTS { #4075, 250V, 2200W → 380V/220V, 3φ, 50/60HZ, 39A
 #4076, 265V, 2200W → 415V/240V, 3φ, 50/60HZ, 39A

5 CONDUCTOR

C	NEW PLATEN THERMOSTAT, DELETE L/D JUMPERS, INCREASE WIRE SIZE. WAS: [1] 11-7-95 DZ
B	ADD "N" BLOCK, REV. "W" WIRING. WAS: [1] 6-M-15 DZ
A	CHANGE WIRE COLOR #1 STAB. CON. WAS BLUE 5-31-91 DZ

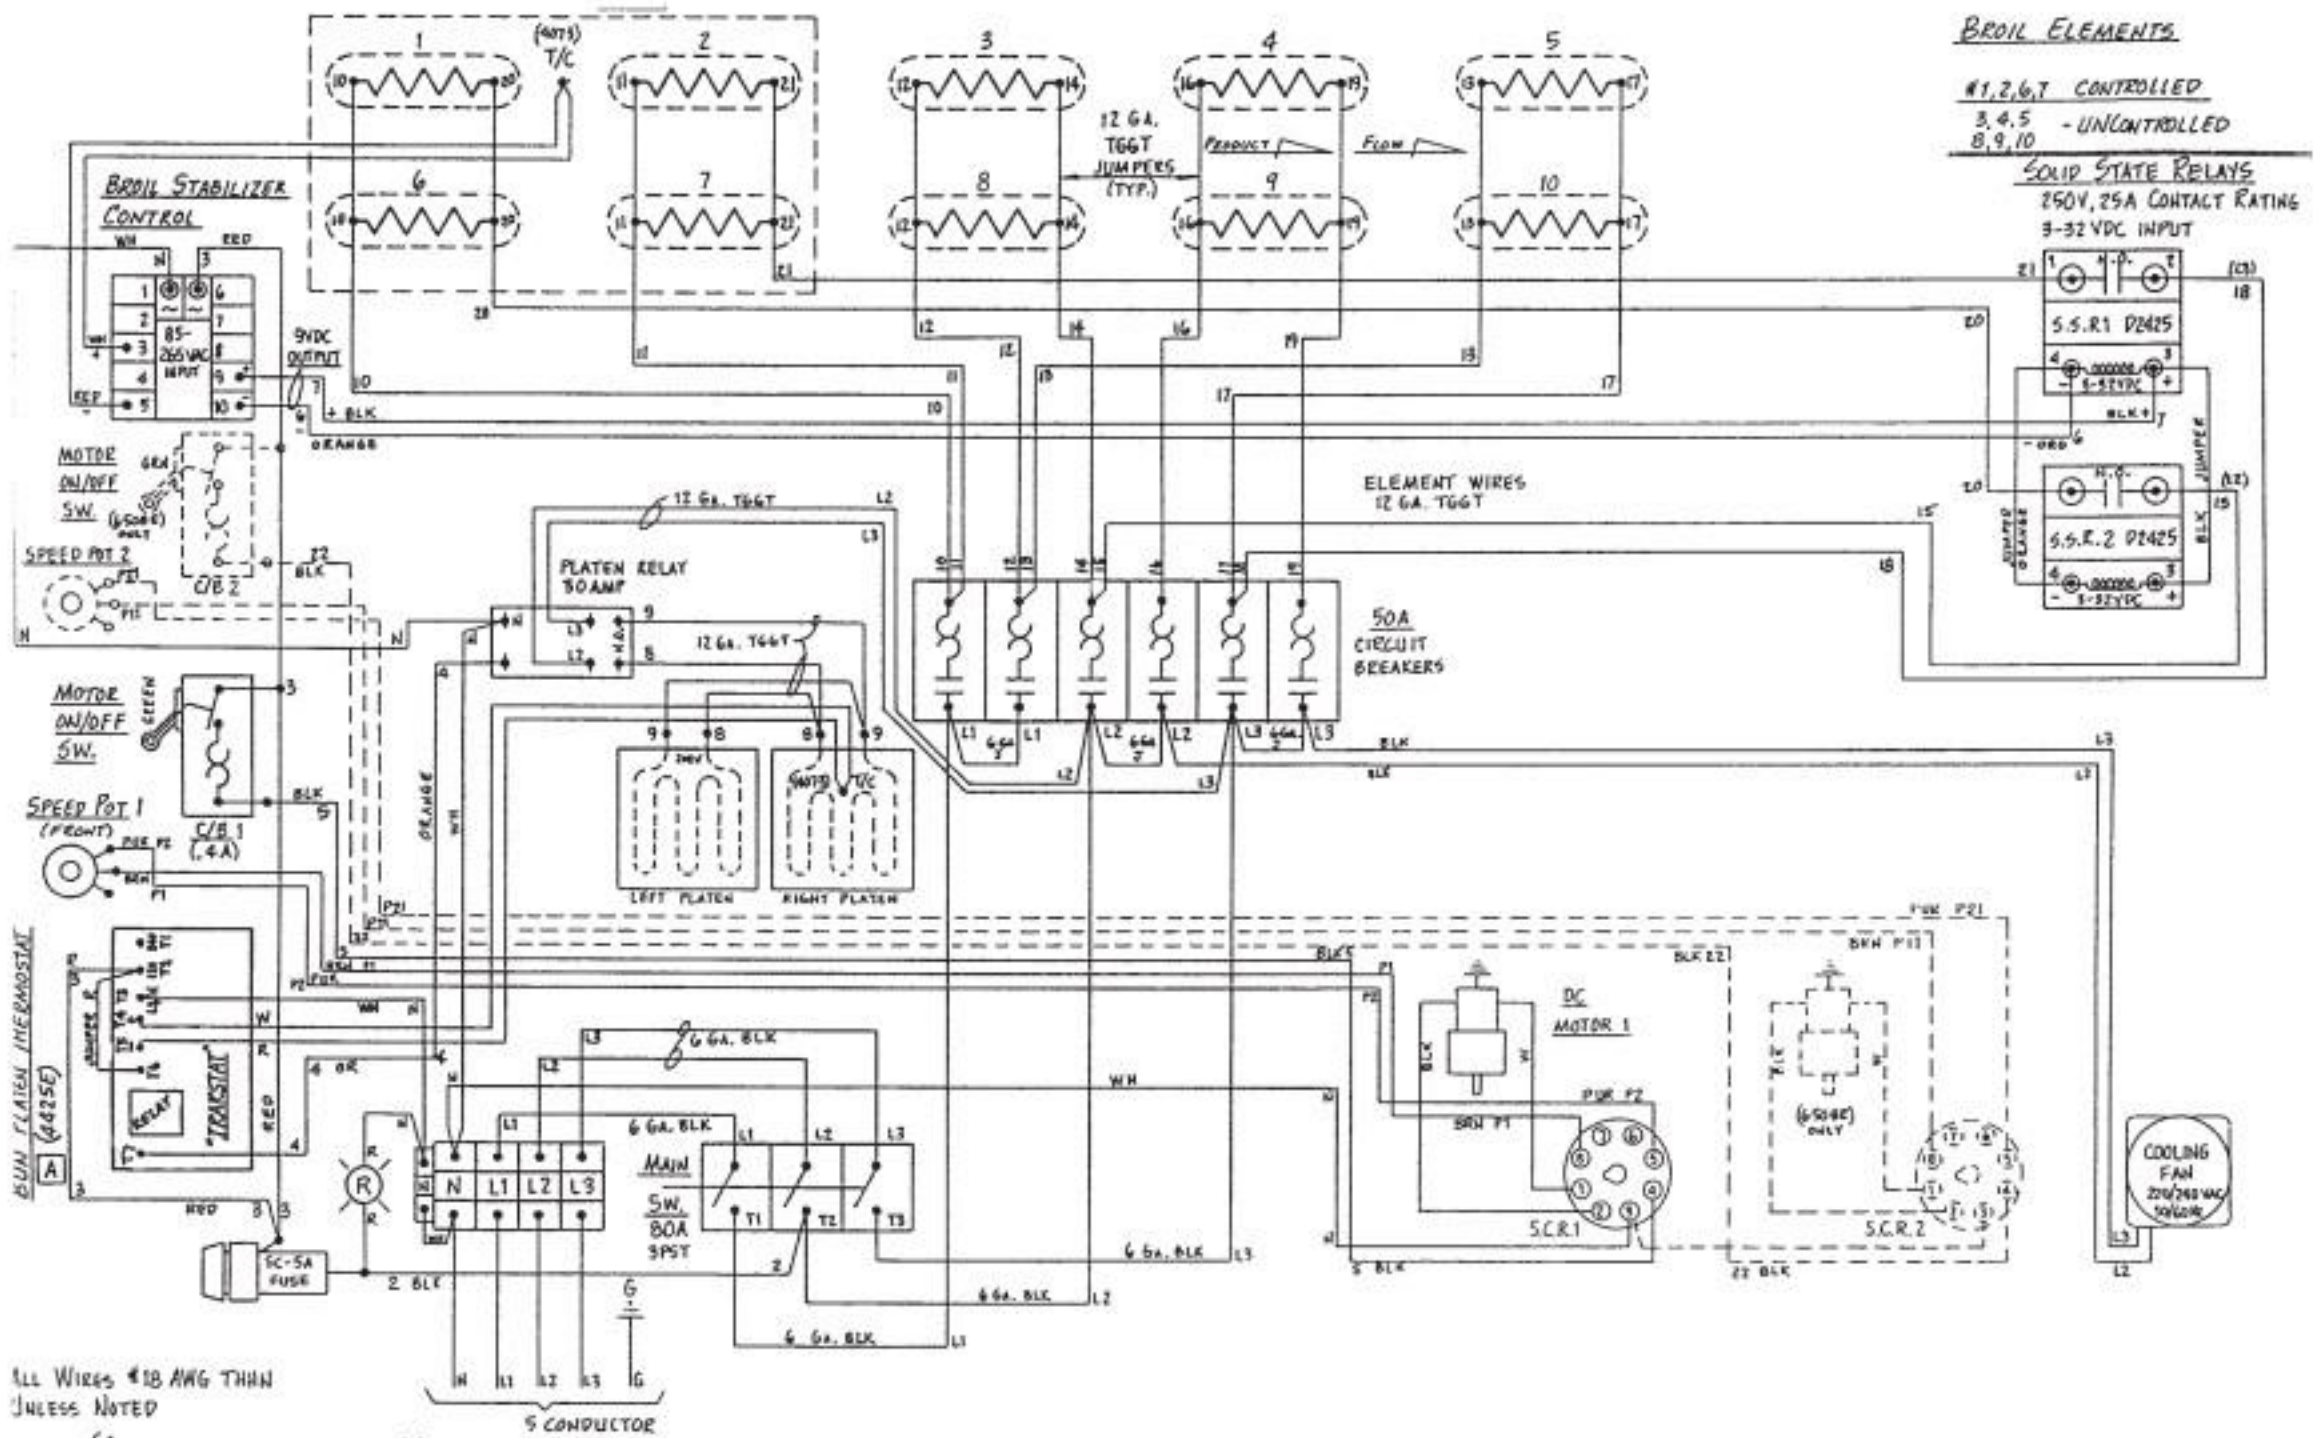

BROIL ELEMENTS
 #1,2,6,7 CONTROLLED
 3,4,5 - UNCONTROLLED
 8,9,10

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 9-32VDC INPUT

ALL WIRES #18 AWG THIN
 UNLESS NOTED


ELEMENTS
 #4081, 240V, 2200W → 208V Y120V, 3ϕ, 50/60HZ, 55A
 #4075, 240V, 2200W → 230V Y120V, 3ϕ, 50/60HZ, 56A

A NEW PLATEN THERMOSTAT, WAS P/N 4071-P 11-7-95/DZ

BROIL ELEMENTS

#1,2,6,7 CONTROLLED
 3,4,5, - UNCONTROLLED
 8,9,10

SOLID STATE RELAYS
 250V, 25A CONTACT RATING
 3-32 VDC INPUT

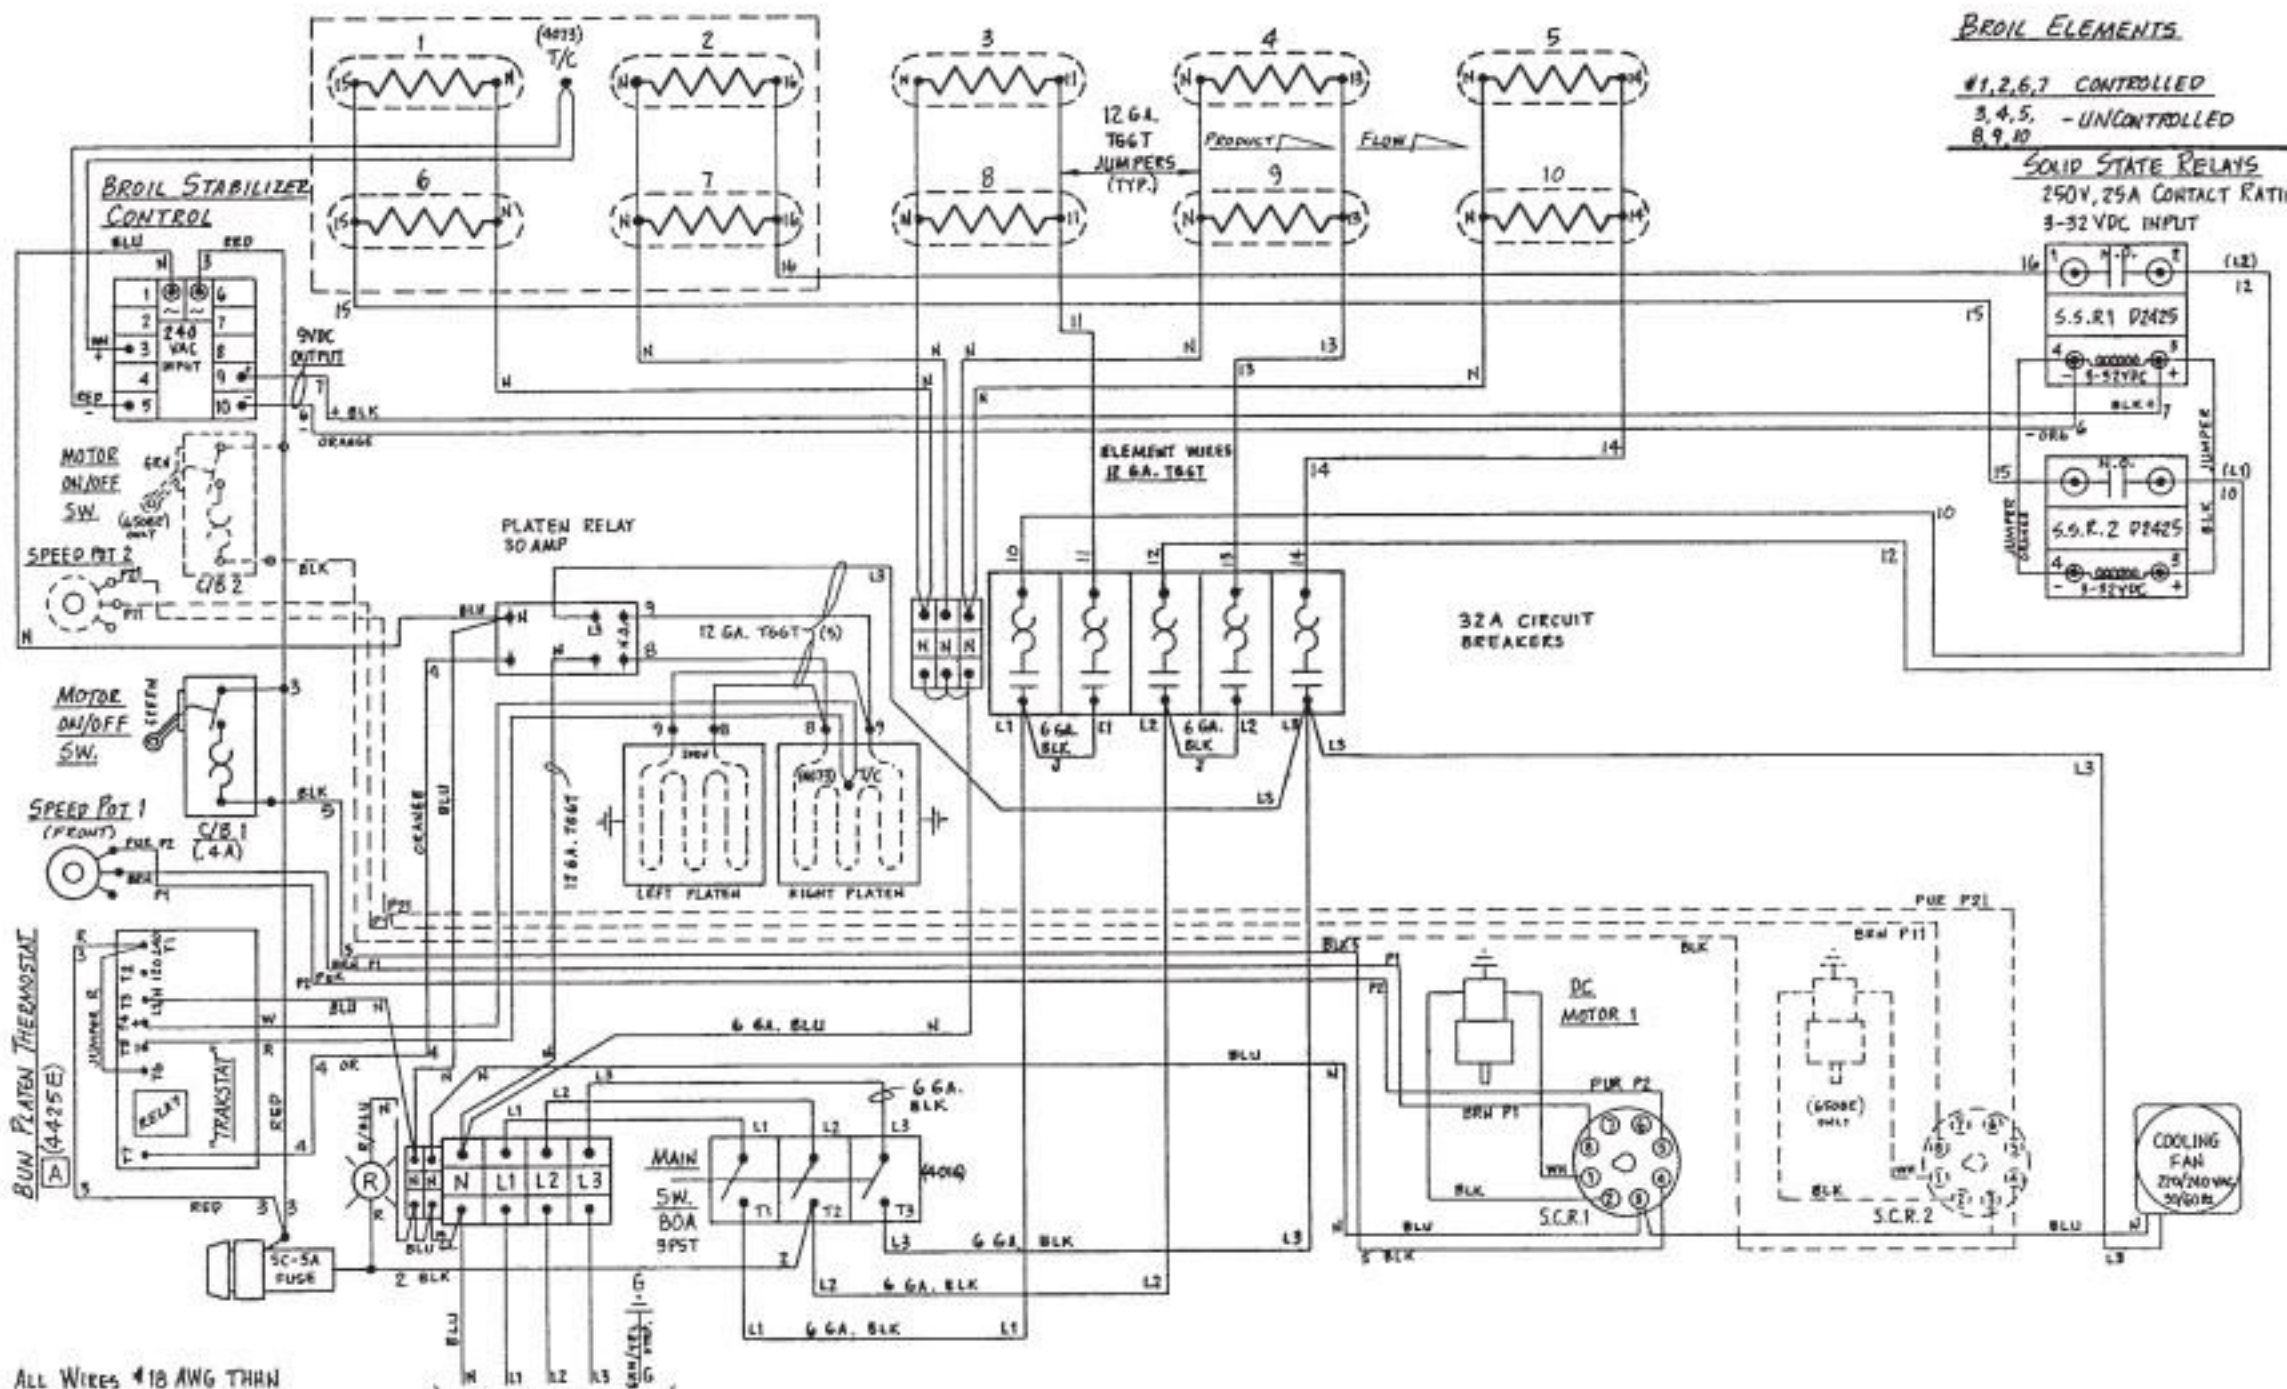

ALL WIRES #18 AWG THIN
 UNLESS NOTED

5 CONDUCTOR
 ELEMENTS { #4075, 250V, 2200W → {380V}220V, 3W, 50/60HZ, 31A
 #4076, 265V, 2200W → {415V}240V, 3W, 50/60HZ, 30A

A NEW PLATEN THERMOSTAT WAS P/N 4071-P (11-7-95) DZ