


ELECTRICAL & GROUNDING CONNECTIONS MUST COMPLY WITH THE NATIONAL ELECTRICAL CODE AND/OR OTHER APPLICABLE LOCAL CODES

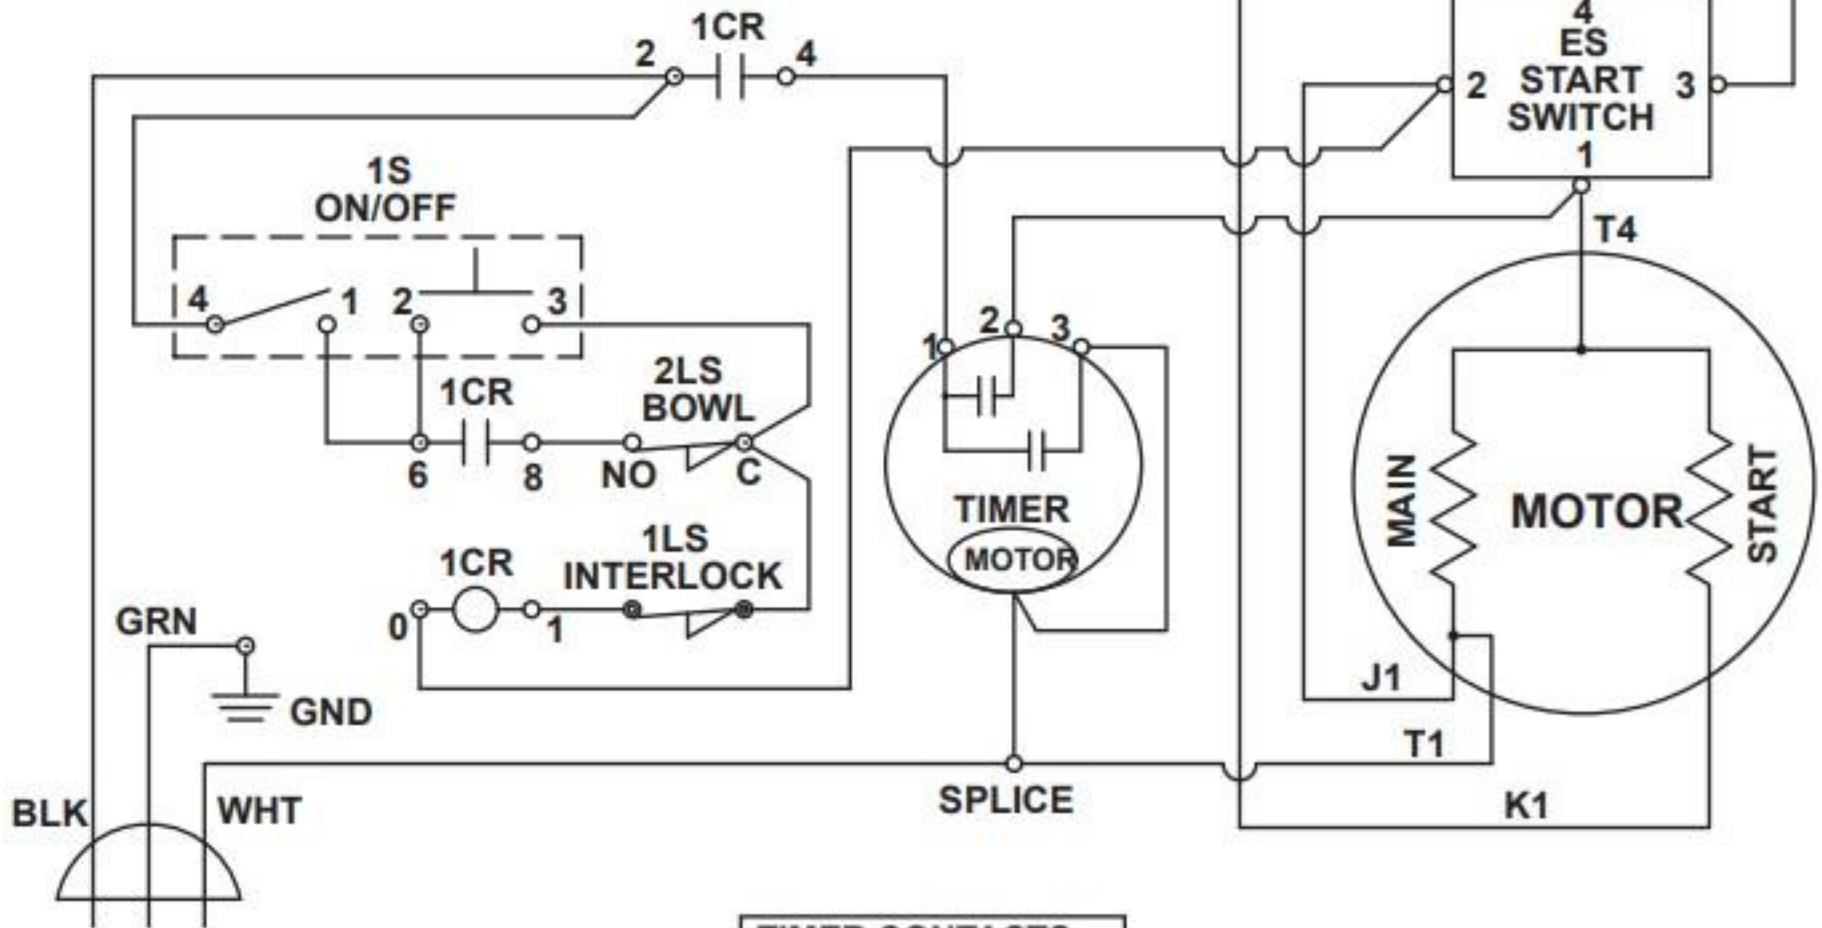

|       | TIMER CONTACTS |           |
|-------|----------------|-----------|
|       | OPEN           | CLOSED    |
| OFF   | 1-2 & 1-3      | ---       |
| HOLD  | 1-3            | 1-2       |
| TIMED | ---            | 1-2 & 1-3 |

WIRING DIAGRAM  
A-200-T MIXER  
UNDER 150 VOLTS