



SERVICE MANUAL



WS-55 Hobart Compact Water Softeners Installation Instructions

WS-55

- NOTICE -

This Manual is prepared for the use of trained Hobart Service Technicians and should not be used by those not properly qualified.

This manual is not intended to be all encompassing. If you have not attended a Hobart Service School for this product, you should read, in its entirety, the repair procedure you wish to perform to determine if you have the necessary tools, instruments and skills required to perform the procedure. Procedures for which you do not have the necessary tools, instruments and skills should be performed by a trained Hobart Service Technician.

The reproduction, transfer, sale or other use of this Manual, without the express written consent of Hobart, is prohibited.

This manual has been provided to you by ITW Food Equipment Group LLC ("ITW FEG") without charge and remains the property of ITW FEG, and by accepting this manual you agree that you will return it to ITW FEG promptly upon its request for such return at any time in the future.

TABLE OF CONTENTS

INSTALLTION	3
INSTALLATION WS-55	3
DISC REPLACEMENT	9
DISC REPLACEMENT WS-55	9
DISC SELECTION	11
DISC SELECTION WS-55	11

INSTALLTION

INSTALLATION WS-55



WARNING Disconnect the electrical power to the machine and follow lockout / tagout procedures.

1. Locate cold water supply line and appropriate drains for softener installation.

NOTE: WS-55 is designed to operate from a cold water supply supply only.

2. Install by-pass valving.



Fig. 1

3. Install prefilter if needed.



Fig. 2

4. Remove all items from shipping package.
5. Locate brass in/out adapters, 4 O-rings, and silicone seal lube.

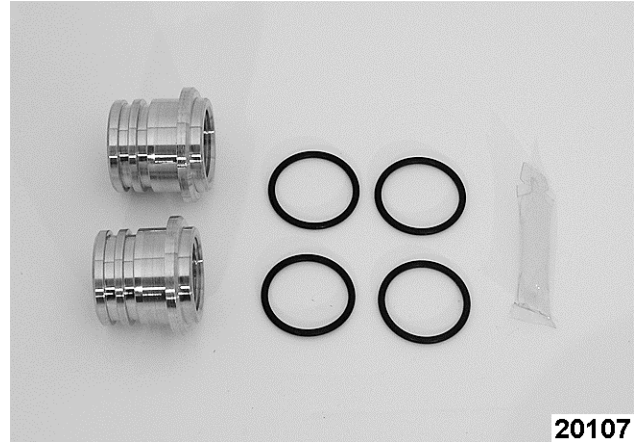


Fig. 3

6. Locate connector hose and output hose from Selecto filter. Apply 2 to 3 wraps of Teflon tape to the male threads.
7. Thread the brass in/out adapters tightly onto the threaded ends of the connector hoses.



Fig. 4

8. Install one O-Ring into each groove of the brass adapter.



Fig. 5

9. Apply a small amount of seal lube evenly onto each O-ring.



Fig. 6

10. Remove the pin and bracket from the softener in/out port area.

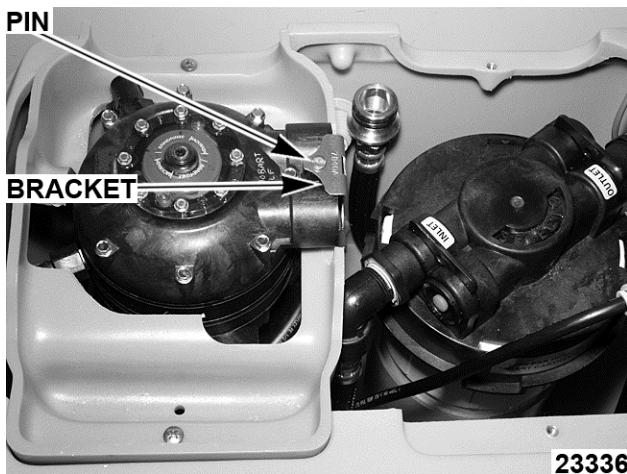


Fig. 7

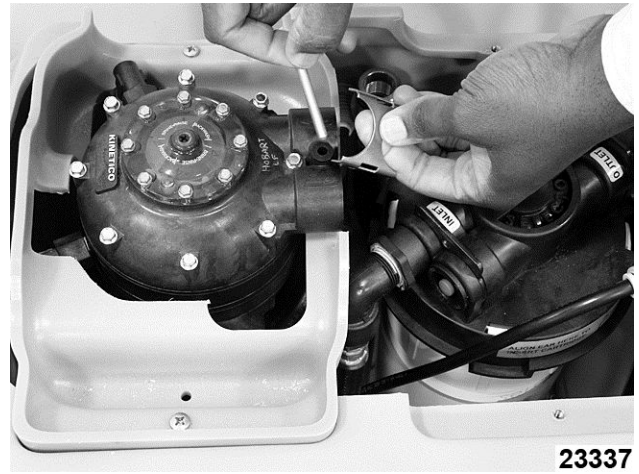


Fig. 8

11. Install the brass adapters into the in/out ports and secure by reinstalling the bracket and pin.

NOTE: The inlet connection from the building supply is connected to the inlet of the carbon block filter head. The outlet from the carbon block filter head is connected to the inlet of the softener head. The outlet from the softener head is connected to the device.

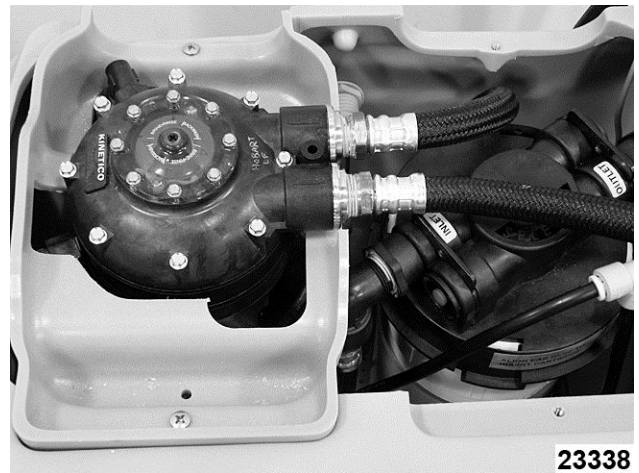


Fig. 9

NOTE: The female end of the connector hoses is designed to thread onto 3/4" pipe thread. Perform appropriate plumbing to provide connections from the water supply to the inlet hose/port and from the outlet port/hose.

NOTE: The inlet port is identified with an arrow pointing towards the softener controls. The softener inlet port will receive the hose which is connected from the outlet of the carbon block filter.

NOTE: The outlet port is identified with an arrow pointing away from the softener controls. The outlet port will be the 60" hose that will connect to the outlet plumbing. The supply connections should be made before the pressure reducing valve.

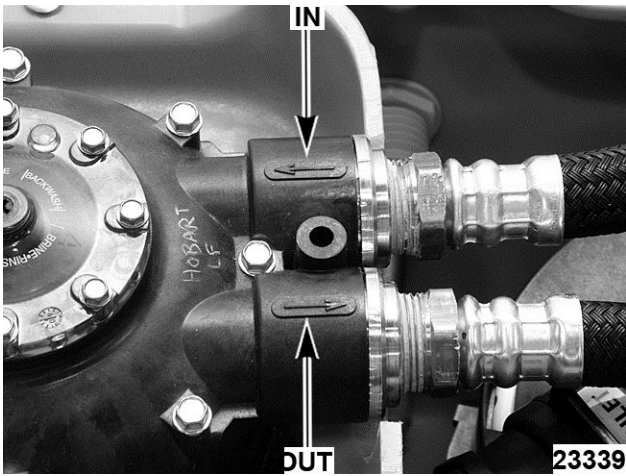


Fig. 10

12. Insert tubing provided into the drain port on the back of the cabinet and run it to an appropriate drain. Be sure to provide a “air gap” between the end of the tubing and the top of the drain.

NOTE: Drain line length should not exceed 8 feet vertical and 30 feet horizontal from the softener.

13. Insert tubing provided into the overflow port on the back of the softener and run drain lower than the cabinet connection to provide a gravity drain in the event of a internal cabinet leak.



Fig. 11

14. Review the meter disc selection chart and the water analysis provided. If no water analysis is provided test the water supply.
15. To test the water supply, use the water analysis test kit available through Pro Products Inc. The recommended kit is #2404 Field Analysis Kit. To order the test kit contact Pro Products at 800-285-9176 or visit www.ProProducts.com.
16. Choose the meter disc and salt setting that best fits the installation parameters.

NOTE: See DISC SELECTION WS-55 at the end of instructions.

17. To remove brine valve assembly, remove tubing from softener cabinet.

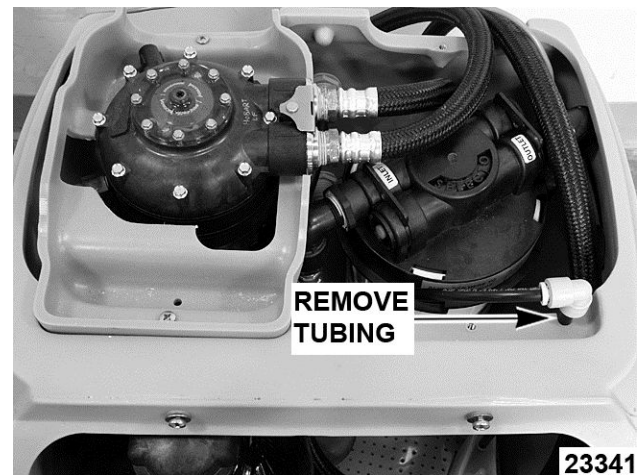


Fig. 12

18. Disconnect tubing from brine valve elbow by holding the collet and pulling tubing straight away.

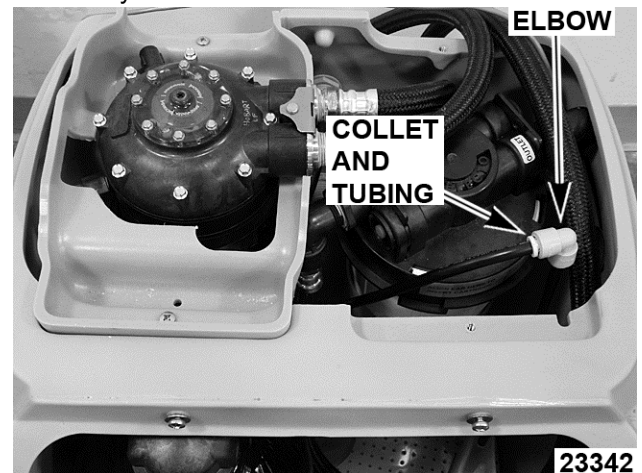


Fig. 13

19. Remove brine valve from the softener cabinet.

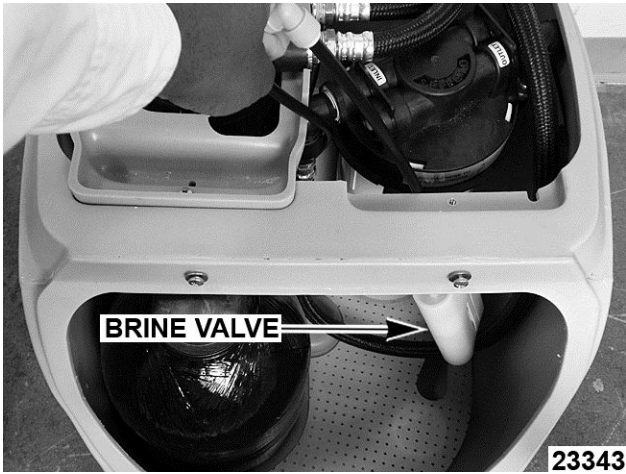


Fig. 14

20. The Float Cup is set by adjusting its height above the bottom of the brine valve assembly. By removing the brine valve assembly and resting it on a flat surface, the height of the Float Cup can be measured with a ruler.

The height is measured from the base of the brine valve assembly to the top of the float cup.

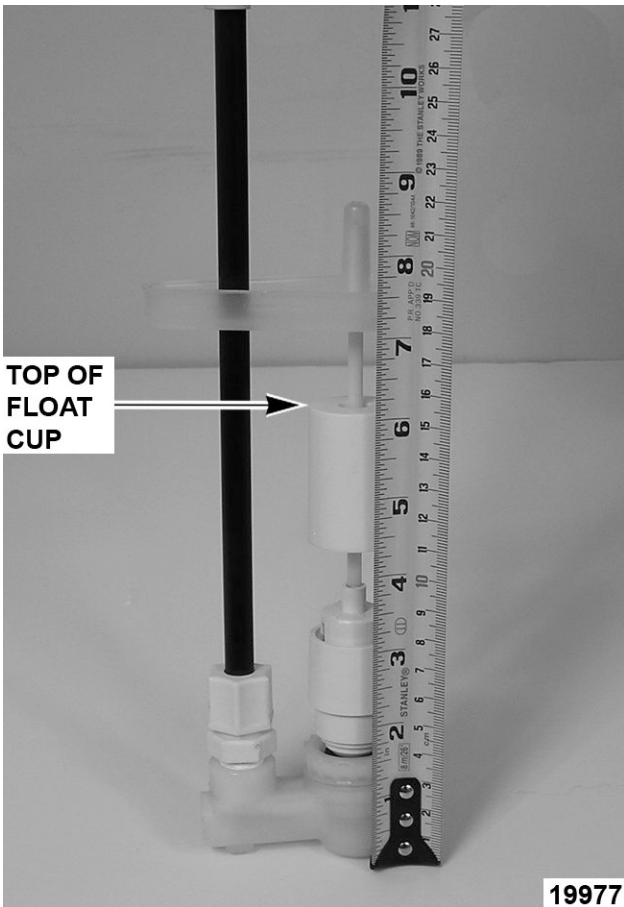


Fig. 15

Brine Valve Settings		
Unit	Brine Setting	Float Cup Height
WS-55	1.4 lb.	6.5"

21. After the adjustments have been made to the float cup, reinstall brine valve into the cabinet.

NOTE: Do not drop the brine valve into the drum. Dropping may lower the float cup, resulting in an improper setting.

22. To install salt alarm system remove paper lining from back of salt alarm connector box.

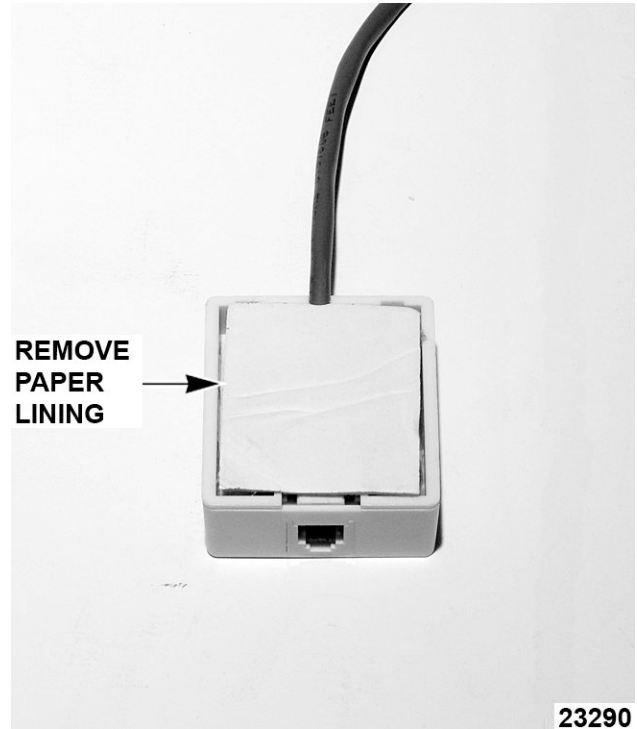


Fig. 16

23. Remove plastic lining from Velcro® backing located on back of salt alarm controller.

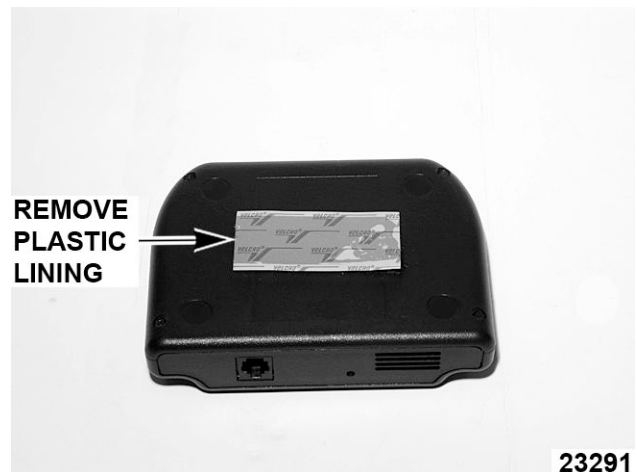


Fig. 17

24. Remove four screws securing back cover to salt alarm controller.

SCREWS




23293

Fig. 18

25. Install three (3) AA batteries into salt alarm controller.

NOTE: When installing batteries - be certain to inspect connector to ensure it is secure.

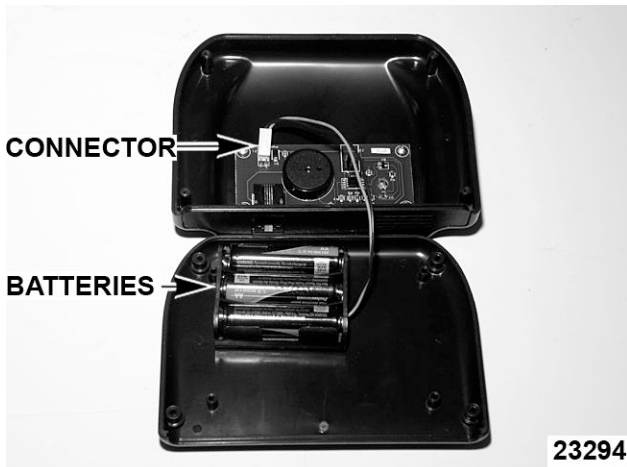


23294

Fig. 19

26. Re-install back cover to salt alarm controller.
 27. Using the adhesive backing on both devices - place alarm controller and salt alarm connector box in a position that will allow salt alarm controller to be seen and heard when it is activated.
 28. Insert phone cable into salt alarm connector box and salt alarm controller.


NOTE: Salt alarm controller can be mounted up to 100 feet from salt alarm connector box using standard phone cable from local retailers (7 foot cable is provided with kit).

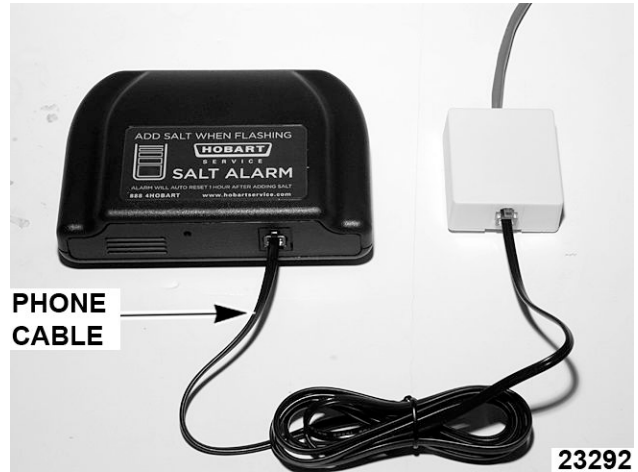

23292

Fig. 20

29. Check for proper operation by pressing the recessed red button on bottom of salt alarm controller. If controller is operating properly - the indicator light will flash and an audible tone will be heard.

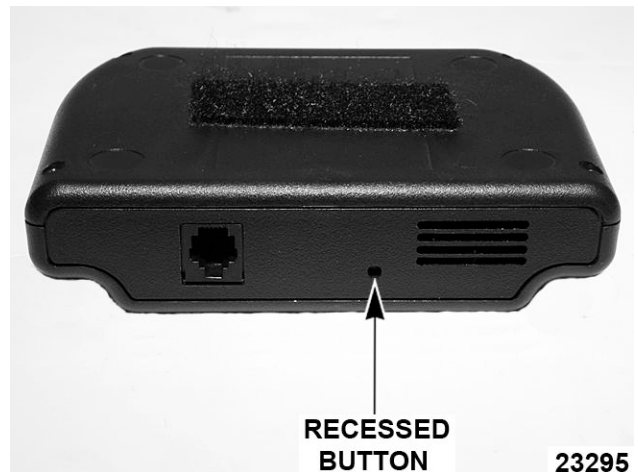

23295

Fig. 21

30. Add a clean grade of salt at this time. Higher grades of Pelletized Salt for impurities and solubility should be used.
NOTE: Do not use rock salt or solar salt.
 31. Open inlet valve slowly allowing system to pressurize.
 32. Water and air will be expelled from drain until system is completely pressurized.
 33. A manual regeneration should be started to purge air and color from softening system. This is done by pushing down on actuator with a Phillips screwdriver and rotating clockwise slowly until pressure is felt.

34. Continue slowly until internal water flow is heard at softener valve. The softener will automatically run through a regeneration. This process should be repeated in 12 to 15 minutes to flush other resin tank.
35. Check for plumbing leaks.
36. Check unit for proper operation.

DISC REPLACEMENT

DISC REPLACEMENT WS-55

1. Remove screws and cap cover from level one.

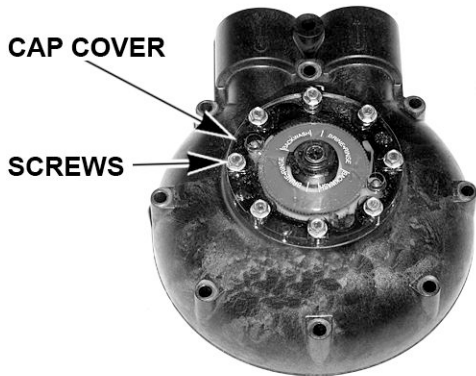


Fig. 22

2. Remove balance piston.

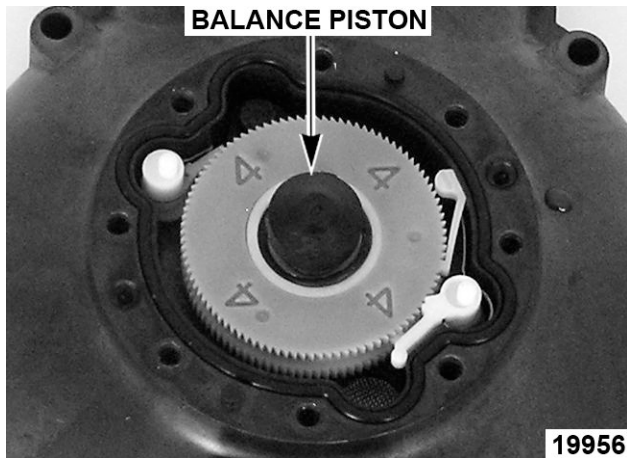


Fig. 23

3. Remove balance piston o-ring and balance piston spring.

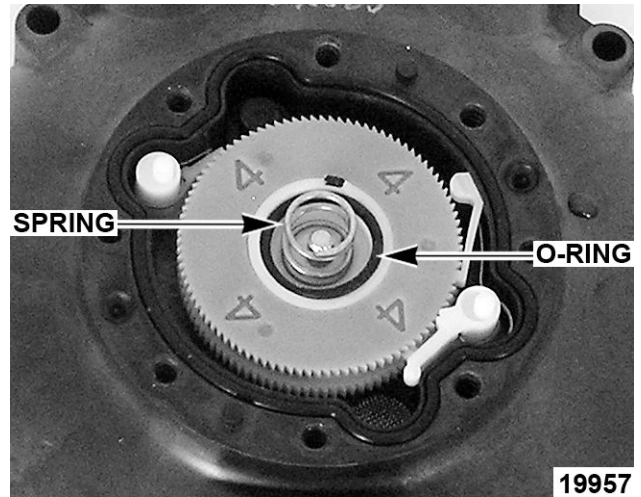


Fig. 24

4. Remove meter drive pawl.

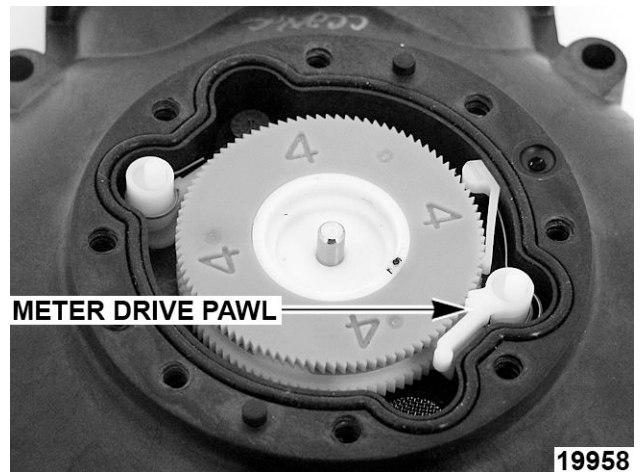


Fig. 25

5. Remove meter disc.

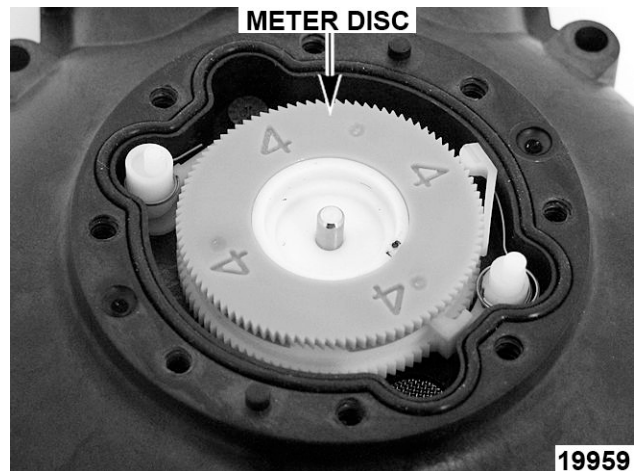


Fig. 26

6. Install correct meter disc and reassemble in reverse order.

NOTE: Make certain all components are correctly installed.

NOTE: Be certain to start cap screws by hand rotating backwards until screw drops into thread then tighten. An alternating, crossing pattern should be used while tightening cap screws to ensure correct cap fit.

DISC SELECTION

DISC SELECTION WS-55

Determining the correct brine valve setting for a particular application is a three step process:

1. Test water supply for hardness and iron content. Use water analysis test kit available through Pro Products Inc. The recommended kit is #2401 Field Analysis Kit. To order test kit contact Pro Products at 800-285-9176 or visit www.ProProducts.com.
2. Determine the compensated hardness for raw water.
 - A. Hardness value in gpg.
 - B. Ferrous iron value in ppm multiplied by 3.
 - C. Add values together.
3. Salt setting is predetermined by height of float cup. Float cup setting is listed in Specification Table.

Specifications

WS-55

Salt usage / generation

1.4 lbs.

Capacity

4,818 grains

Efficiency

3,442 gr./lb.

Dosing

3.5 lbs./cu. ft.

Float cup setting

6.5"

WS-55 Disc Selection								
Disc Number	1	2	3	4	5	6	7	8
Compensated Hardness *	6	13	25	27	30	35	37	40
Gallons Between Regeneration	591	296	166	148	118	99	84	74
Regeneration Gallons Per Minute @ 15 psig	5	5	5	5	5	5	5	5
* Compensated hardness in gpg = Hardness + (3 x Fe in ppm)								